


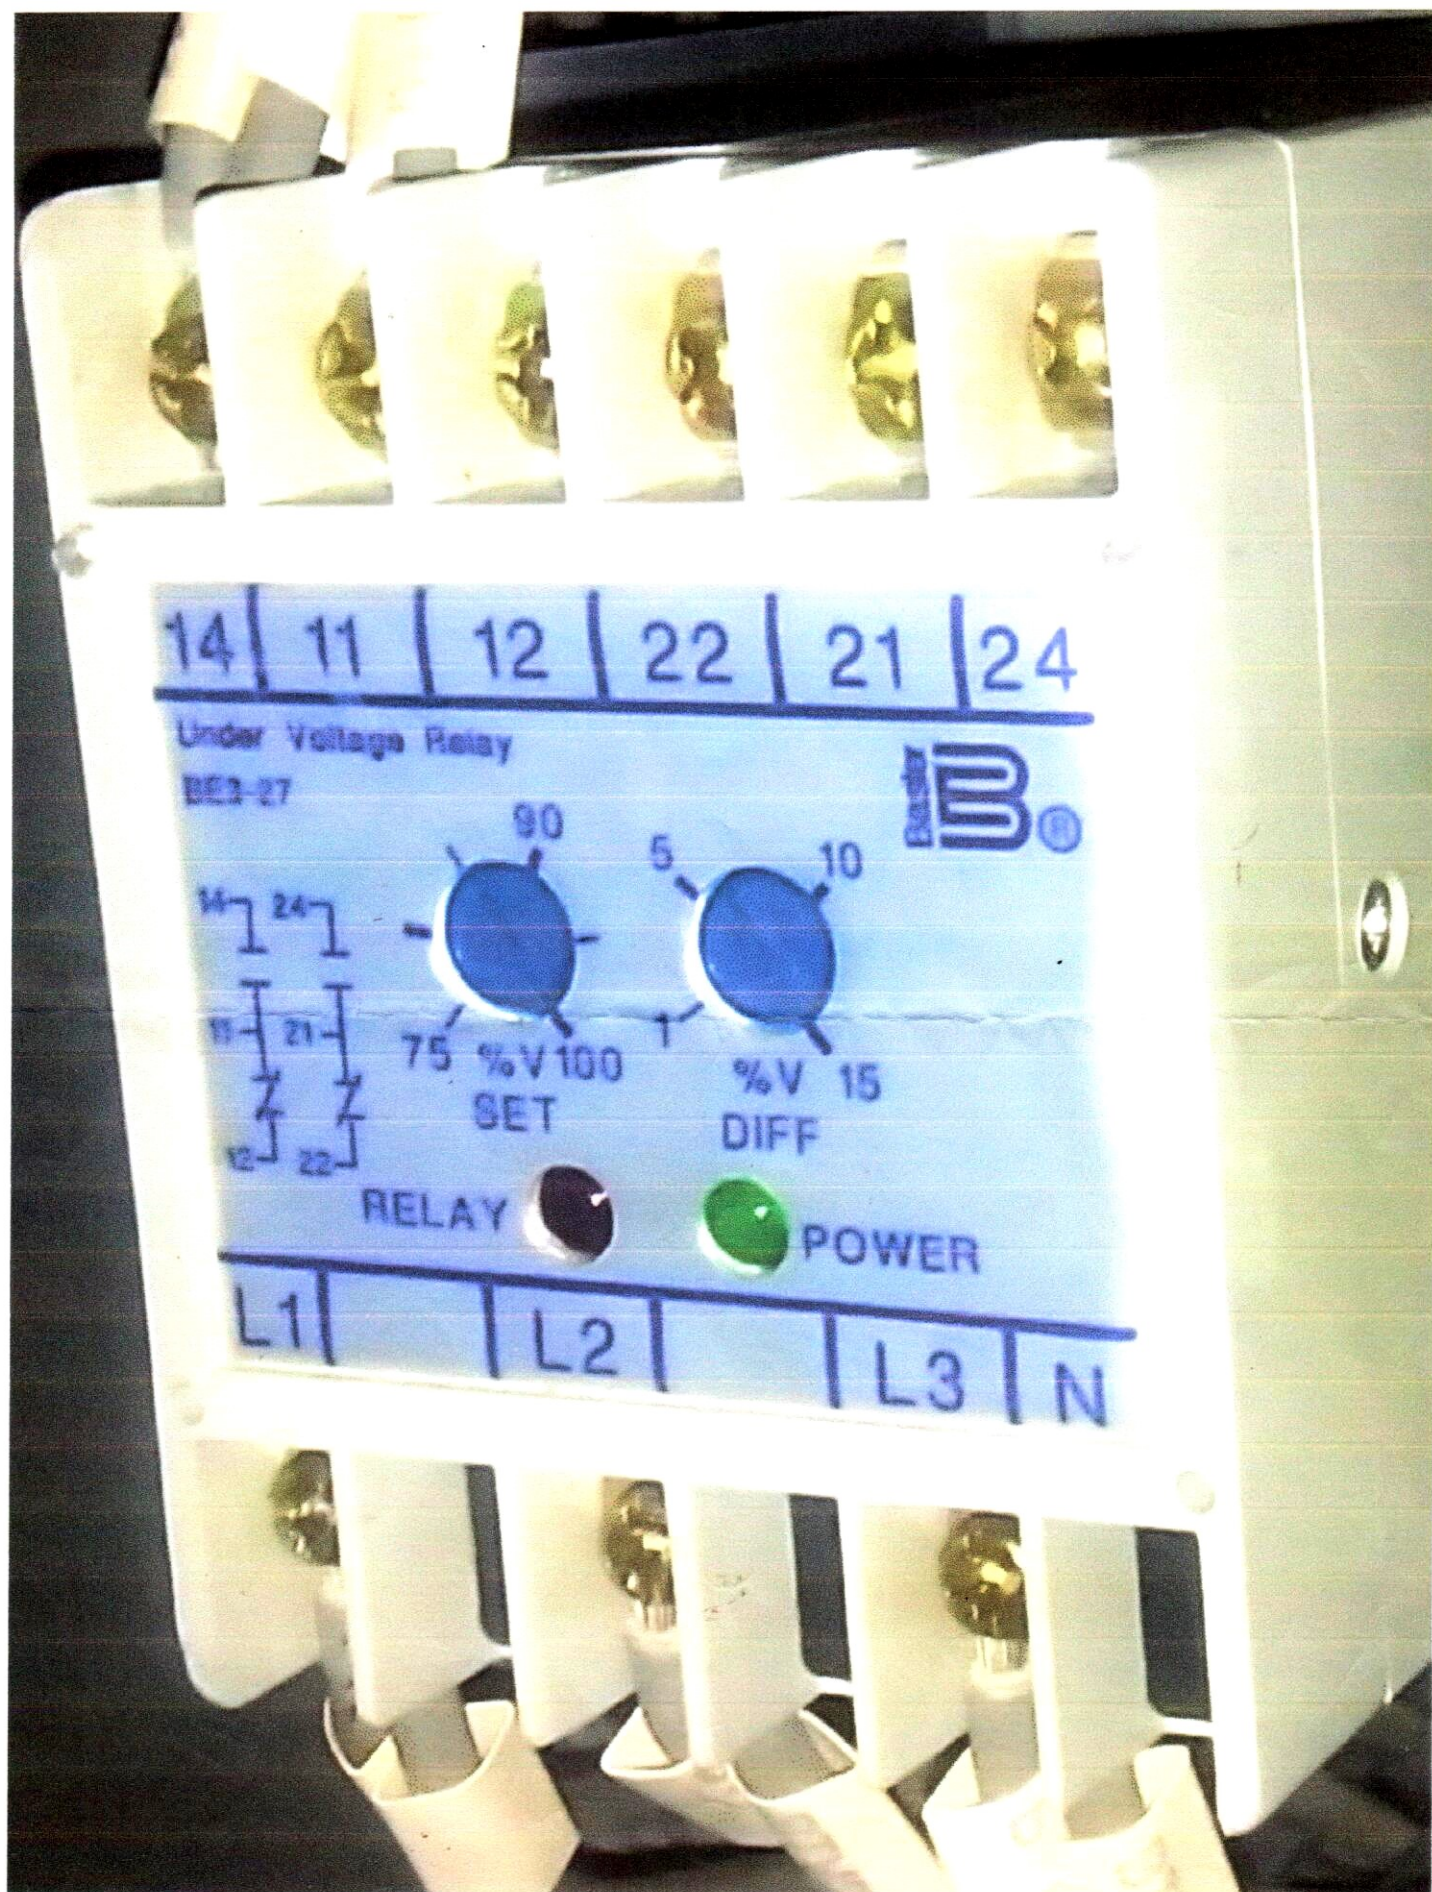

UNDER VOLTAGE RELAY
MEASURING input : $3 \times 130V_{\text{OLT}}$ - 60Hz
OUTPUT : ONE CHANGE OVER CONTACT
ADJUSTABLE SET POINT $\sim 15\%$